
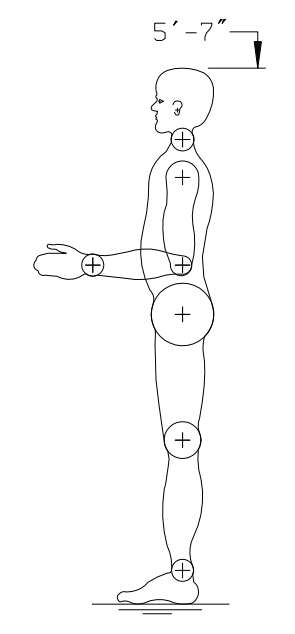
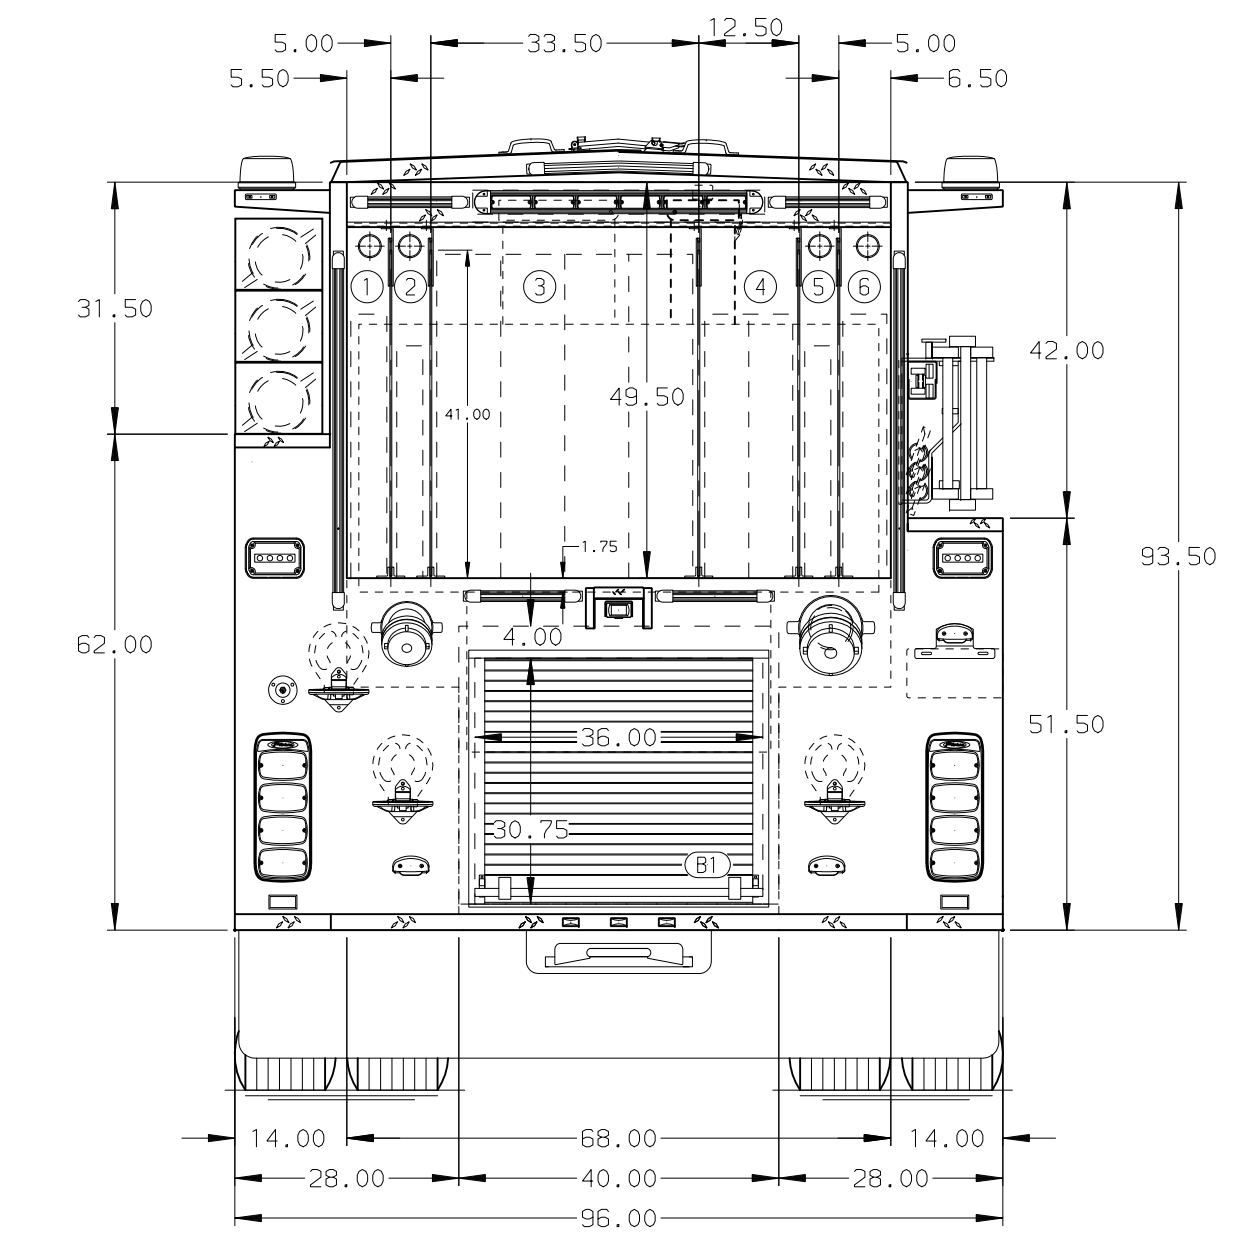


- HOSEBED CAPACITIES
- ① 250' OF 2.50" D.J. HOSE
  - ② 250' OF 1.75" D.J. HOSE
  - ③ 1300' OF 5.00" L.D.H. HOSE
  - ④ 500' OF 3.00" D.J. HOSE
  - ⑤ 250' OF 1.75" D.J. HOSE
  - ⑥ 250' OF 3.00" D.J. HOSE

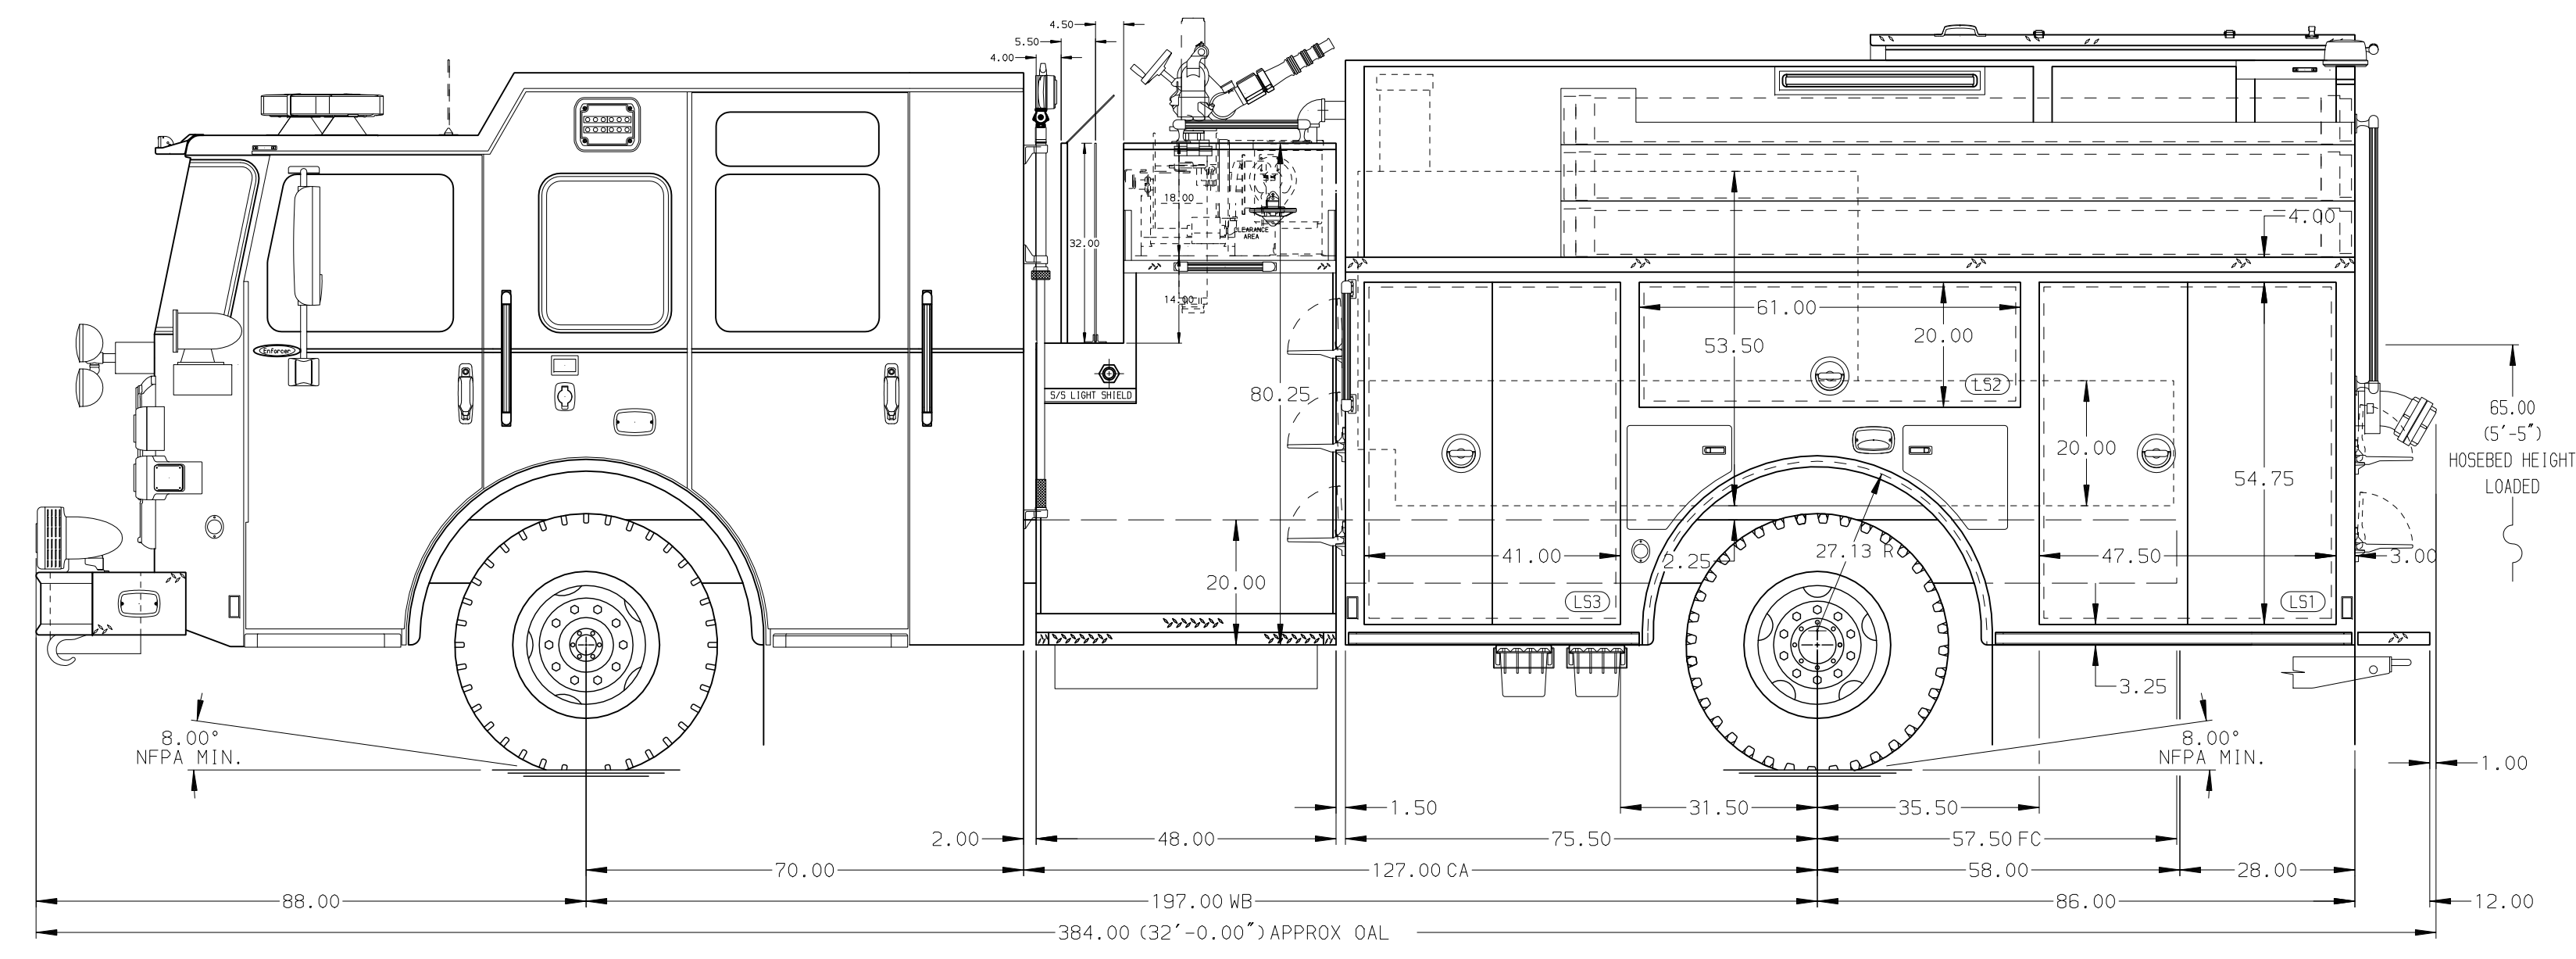

ALUMINUM BODY

NOTE  
DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

CUSTOMER APPROVAL			
APPROVED BY:			
DATE:			
REV	DATE	BY	CH

**Pierce** MANUFACTURING INC.

TITLE: 2000-1000P, 980G WATER, 20G FOAM, 161" PUMPER BODY (2) CROSSLAYS, DELUGE, GENERATOR, CABLE REEL

FOR: MILL CREEK BOROUGH VOLUNTEER FIRE COMPANY INC BID# 781 GLICK FIRE EQUIPMENT CO, INC. RANDY UHRICH

DWG NO. 05-0516

JOB NO.	PRELIM
SCALE	1:24
DATE	
DRAWN BY	JUS
CHECKED BY	NPA
SHEET SIZE	D
SHEET NO.	1 OF 1